


Standard Dimensions
(Metric on Reverse Side)

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6470 www.carnes.com

FOR USE WITH MODEL VRBK RESTAURANT EXHAUST FAN

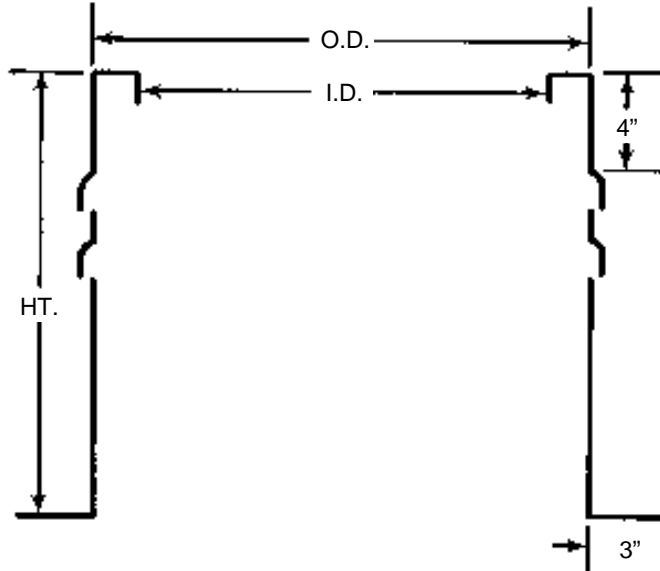

ALL DIMENSIONS LISTED IN INCHES

VRBK SIZE	CURB CAP ID	CURB O.D.	CURB I.D.	CURB HT.*
06	15-1/2	15	12	26
08	15-1/2	15	12	26
10	17-5/8	17	14	24
12	17-5/8	17	14	24
15	20-1/2	20	17	20
18	25	24-1/2	21-1/2	18
21	28-1/8	27-1/2	24-1/2	18
24	31-1/8	30-1/2	27-1/2	18
30	40-1/8	39-1/2	36-1/2	18
36	46-1/8	45-1/2	42-1/2	18
42	54-1/8	53-1/2	50-1/2	18
48	58-1/8	57-1/2	54-1/2	18

STANDARD CONSTRUCTION

- Continuously welded 18 gauge galvanized steel
- Neoprene gasketing (For Field Installation)
- 5" wide by 1" high louvered slots, 4 per side, on all sides
- No insulation; no wood nailer
- Aluminum construction optional

*Curb height selected to allow 18" welded duct height and maintain 40" discharge height required per NFPA 96.

CURB SIZE DESIGNATION

First 3 digits "A" Dimension in inches, 4th digit number of eights in fraction (1/2" is 4 eights). Size 24-1/2" x 36" would be SIZE: **0244 0360**.

LOCATION/MARK	QUANTITY	MODEL	SIZE	HEIGHT	OPTION

NOTES

PROJECT:

ARCHITECT:

CONTRACTOR:

DATE:


SUBMITTED BY:

ENGINEER:

Metric Dimensions
(Standard on Reverse Side)

CARNES COMPANY 448 S. Main St., P. O. Box 930040, Verona, WI 53593-0040 Phone: (608)845-6411 Fax: (608)845-6470 www.carnes.com

FOR USE WITH MODEL VRBK RESTAURANT EXHAUST FAN

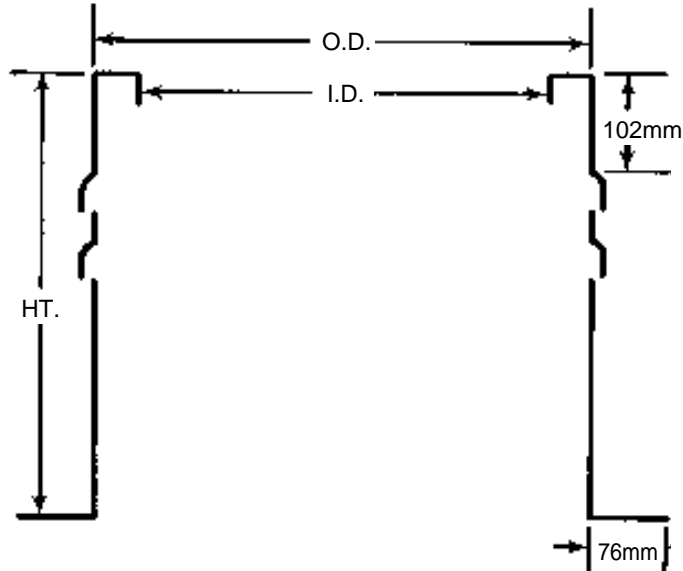

ALL DIMENSIONS LISTED IN MILLIMETERS

VRBK SIZE	CURB CAP ID	CURB O.D.	CURB I.D.	CURB HT.*
06	394	381	305	660
08	394	381	305	660
10	448	432	356	610
12	448	432	356	610
15	521	508	432	508
18	635	622	546	457
21	714	699	622	457
24	791	775	699	457
30	1019	1003	927	457
36	1172	1156	1080	457
42	1375	1359	1283	457
48	1476	1461	1384	457

STANDARD CONSTRUCTION

- Continuously welded 18 gauge galvanized steel
- Neoprene gasketing (For Field Installation)
- 127mm wide by 25mm high louvered slots, 4 per side, on all sides
- No insulation; no wood nailer
- Aluminum construction optional

**Curb height selected to allow 18" welded duct height and maintain 40" discharge height required per NFPA 96.*

LOCATION/MARK	QUANTITY	MODEL	SIZE	HEIGHT	OPTION

NOTES

PROJECT:			ARCHITECT:		
CONTRACTOR:		DATE:	SUBMITTED BY:		ENGINEER: