

ARI Certified Performance Rating Program

Variable Air Volume Terminals



ARI is . . .


A certification program that references Standard 880-98 for sound and air flow performance of Air Terminals.

The Certification Program emphasizes compliance by all participating manufacturers to the requirements of Standard 880-98.

The Standard requires that participating manufacturers of Air Terminals establish their certified ratings and performance at the Standard Rating Condition.

The ARI certification symbol may only be displayed on terminal units that were certified under the requirements of Standard 880-98.

The ARI Certification Program is designed to assure engineers, contractors and consumers that products manufactured by a program participant have been accurately rated.

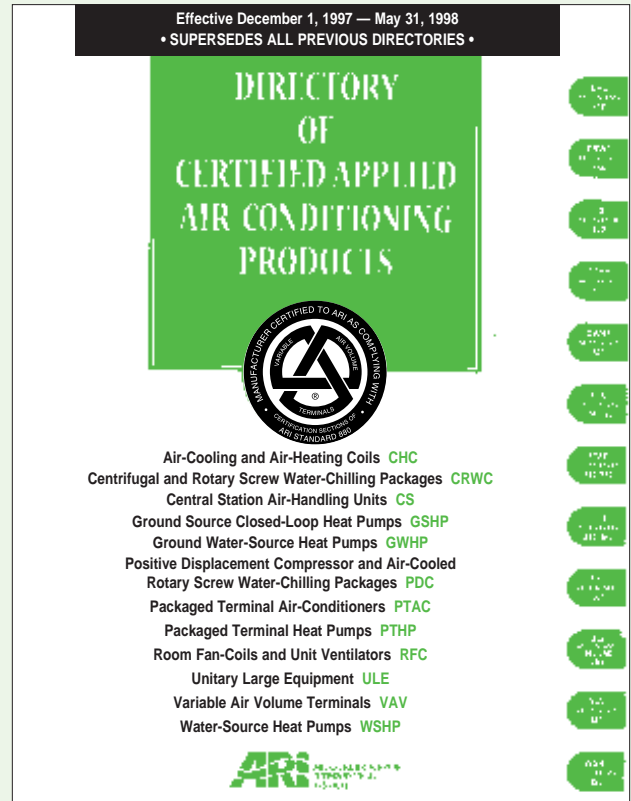

The ARI Directory of Certified Applied Air-Conditioning Products is available by request.

Write to: **Air Conditioning & Refrigeration Institute**
4301 North Fairfax Drive
Suite #425
Arlington, VA 22203
(703) 524-8800
www.air.org

ASX Terminal Unit Models AV, AD, AH, AS, AC, and AQ are certified to display the ARI Certification Symbol along with the statement "Rated in accordance with Standard 880-98." Look for the ARI Seal and specify ASX VAV Terminals and ARI Certified Performance.